



KAISER ♦ HILL  
COMPANY  
**MEMORANDUM**


DATE: March 3, 2004  
TO: Building Notification File: B569/570  
FROM: Steve Nesta  
SUBJECT: **ADDITIONAL INFORMATION FOR B569/570 CLOSEOUT REPORT**

---

CDPHE has provided comments regarding the Type 1 Closeout Report for Buildings 569 and 570. This memorandum documents the additional information identified by CDPHE.

**Buildings 569/570 (Type 1 Facility)**

- ◆ The sewer line that serviced Buildings 569/570 was flushed per normal procedure. That includes a short flush duration with a high volume (at least 5 times the volume of the pipe) of water.
- ◆ The sewer line was not removed to Manhole 202 because the manhole was still active. MH202 is no longer active. The sewer line was plugged at the west inlet to MH202, 5' below grade. The east outlet is still active, also 5' below grade.
- ◆ Manhole 202 still remains. Kaiser Hill is awaiting a response from CDPHE on a submitted, draft of a general strategy to remove all inactive manholes.
- ◆ The water line for Buildings 569/570 was cut and capped near the "T" intersection, 7' below grade. Approximately 100' of water line remains, plugged and 7' below grade.

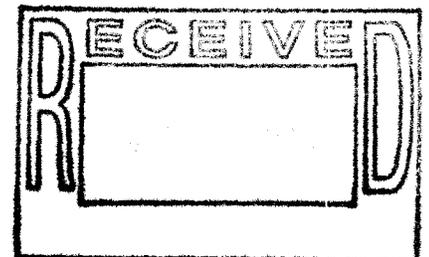

ADMIN RECORD

DOCUMENT CLASSIFICATION  
REVIEW WAIVER PER  
CLASSIFICATION OFFICE

IA-A-002005